



Marine Corps Base Quantico
 Crossroads of the Marine Corps
 2012 Annual Drinking Water Quality Report
 Mainside Water System PWSID 6153675



Introduction

Marine Corps Base Quantico G-5, Installation and Environment Division, is pleased to present the Base's Mainside Annual Water Quality Report for 2012. This report is designed to inform you about the quality of water and services we deliver to you every day.

Our constant goal is to provide you, the consumer, with a safe and dependable supply of drinking water.

We are committed to ensuring the quality of your water. To help us meet this goal, we have established a Water Quality Response Team. Personnel from the Base Naval Health Clinic join with our Physical Science Technician, to respond to customer concerns and water quality questions. Together, they have the resources to test the chemical and bacteriological quality at the consumers tap.

Our Mainside water (PWSID No. 6153675) comes from protected surface water sources. The water is processed at the Mainside Water Treatment Plant.

Base Waterworks Receives Award




For the fifth consecutive year, the Base Water Facility received the BRONZE Excellence in Filter Performance Award for 2012. The Virginia Department of Health (VDH), Office of Drinking Water, recognized the Base for achieving Virginia's Optimization Program Goal for Filtration. The Base Water Works succeeded in providing filtration performance three times below the United States Environmental Protection Agency (USEPA) standards.

Lower water plant output turbidity indicates a higher rate of particulate removal; USEPA standard is 0.3 NTU (see definition in data table). The Base waterworks consistently maintained an effluent turbidity well below 0.10 NTU. The low turbidity allows for an extremely effective disinfection process. Turbidity average for filter performance for 2012 is 0.04 NTU.

Summary

The Mainside Water Treatment Plant routinely monitors for constituents in your drinking water according to State and Federal laws. This report shows the results of our monitoring for the period January 1 through December 31, 2012.

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally

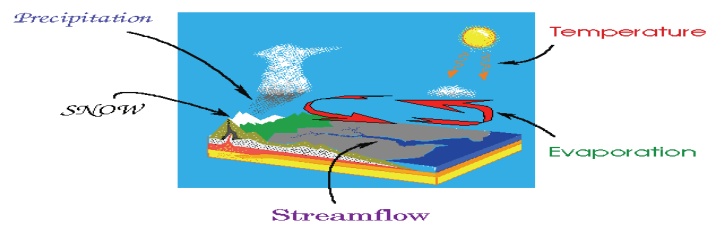

occurring minerals and in some cases radioactive material and can pick up substances resulting from the presence of animals or from human activity.

Contaminants that may be present in source water include:

- i. **microbial contaminants**, such as viruses and bacteria, which may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.
- ii. **inorganic contaminants**, such as salts and metals, which can be naturally occurring or result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.
- iii. **pesticides and herbicides**, which may come from a variety of sources such as agriculture, urban stormwater runoff, and residential uses.
- iv. **organic chemical contaminants**, including synthetic and volatile organic chemicals, which are byproducts of industrial processes and petroleum production, and can also come from gas stations, urban stormwater runoff, and septic systems.
- v. **radioactive contaminants**, which can be naturally occurring or be the result of oil and gas production and mining activities.

In order to ensure that tap water is safe to drink, USEPA prescribes regulations that limit the amount of certain contaminants in water provided by public water systems. U.S. Food and Drug Administration (FDA) regulations establish limits for contaminants in bottled water.

Drinking water, including bottled water, may reasonably be expected to contain at least a small amount of some contaminants. The presence of contaminants does not necessarily indicate that the water poses a health risk. More information about drinking water contaminants and potential health effects can be obtained by calling the USEPA's Safe Drinking water Hotline at 1-800-426-4791 or visiting their website at

<http://water.epa.gov/drink/index.cfm>.

The Facts

This report contains information on all regulated contaminants found in your drinking water. Additionally, over 85 water tests are performed for a variety of contaminant not found in the water delivered to the Base.



An explanation of the results is included in a data table at the end of this report.

Maximum Contaminant Levels (MCL's) are set at very stringent levels by the USEPA. In developing the standards USEPA assumes that the average adult drinks 2 liters of water each day throughout a 70-year life span. USEPA generally

sets MCL's at levels that will result in no adverse health effects for some contaminants or a one-in-ten-thousand to one-in-a-million chance of having the described health effect for other contaminants. The VDH conducted a source water assessment in 2002. The purpose was to determine the relative susceptibility of the source water to activities in the watershed. Our source water was calculated to have a high susceptibility to contamination due to ongoing Base activities. There was no evidence of contamination of the water source in any of our testing.


Microbial Analysis

Total Coliform: *Coliforms* are bacteria that are present naturally in the environment and are used as an indicator that other, potentially harmful bacteria, may be present.

When Coliform bacteria are found, special follow-up tests are done to determine if harmful bacteria are present in the water supply. If the limit is exceeded, the water supplier must notify the public by newspaper, radio, or television. *We are pleased to announce the Base was in compliance.*

The Distribution System

We encourage our customers to contact us to report their observations. At that time, we will visit the site and determine if we need to run additional tests. If you have any questions about this report or concerning your water utility, please contact Mr. Larry Weedon, Utility and Energy Manager at (703) 784-2246 or (703) 432-0698.

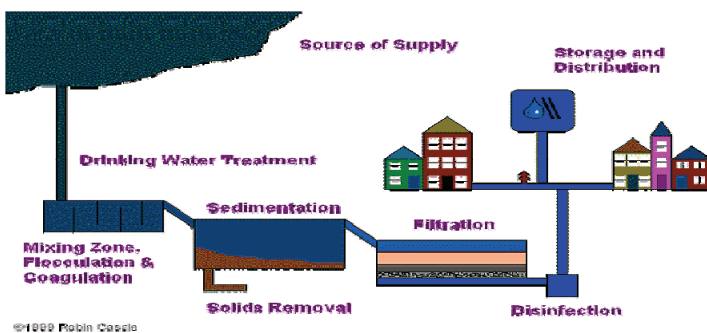

Water Plant Upgrades

Public Works Branch is currently working on a contract to inspect the interior of the filters and replace the filter media, this work is required so the Base can continue to meet the EPA Standards for individual filter turbidity's. Included in the referenced contract is additional treatment equipment and updated monitoring devices.

Should Some People Take Special Precautions?

Some people may be more vulnerable to contaminants in drinking water than the general population. Immune system compromised persons such

as persons with cancer undergoing chemotherapy, people who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly and infants can be partially at risk from infections. These people should seek advice about drinking water from their health care providers. USEPA/CDC guidelines on appropriate means to lessen the risk of infection by cryptosporidium and other microbiological contaminants are available from the USEPA Safe Drinking Water Hotline at 1-800-426-4791. We constantly monitor the water supply for various contaminants. **We strongly recommend that our customers not use water from the hot water tap for consumption.**

Any contaminants found in the water may accumulate in the hot water tank. This would be true anywhere, regardless of the water source. This does not mean that there is anything wrong with our drinking water. All water tests are conducted on water from the cold-water tap. Our concern is that the water quality is unknown when water from the hot-water tap is consumed. We believe you are better served by heating cold-water for this purpose.

Lead and Copper

During August and September 2012, the Base completed testing for Lead and Copper in the distribution system. Samples from thirty sites were tested according to an approved sampling plan. All samples were below USEPA Action Level (15 ppb). As a result, the next sample event for lead and copper is scheduled in 2015.

More information about drinking water contaminants and potential health effects can be obtained by calling the USEPA's Safe Drinking water Hotline at 1-800-426-4791 or visiting their website at <http://water.epa.gov/drink/index.cfm>. If present, elevated levels of lead can cause serious health problems, especially for pregnant women and young children. Lead in



drinking water is primarily from materials and components associated with service lines and home plumbing. Marine Corps Base Quantico is responsible for providing high quality drinking water, but cannot control the variety of materials used in plumbing components.

When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 15 to 30 seconds, until it becomes cold or reaches a steady temperature before using the water for drinking or cooking. If you are concerned about lead in your water, you may wish to have your water tested. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available from the USEPA's Safe Drinking water Hotline at

1-800-426-4791 or visit <http://water.epa.gov/safewater/lead>.

Additional Tests and Monitoring Unregulated Contaminant Monitoring Rule 2 (UCMR2)

The Safe Drinking Water Act (SDWA), as amended in 1996, requires the USEPA to establish criteria for a program to monitor unregulated contaminant and publish a list of contaminants to be monitored every five years. USEPA published the first set of contaminants in 1999. This final regulation meets the Safe Drinking Water Act (SDWA) requirement by publishing the next set of unregulated contaminants to be monitored and the requirements for such monitoring. This final rule describes a design for second Unregulated Contaminant Monitoring Cycle (UCMR2) of 2007-2011. USEPA is requiring the monitoring of 25 chemicals using 5 different analytical methods. UCMR 2 monitoring began in 2008 and was completed in 2010.

Implementation of this final rule benefits the environment by providing USEPA and other interested parties with scientifically valid data on the occurrence of the contaminants in drinking water; thereby, permitting the assessment of the population potentially being exposed and the levels of exposure. These results are the primary resource of occurrence and provide exposure data for the USEPA to determine whether to regulate these contaminants.

UCMR2 testing for 2008 through 2010 indicates all constituents (e.g. flame retardants, pesticides, explosives) tested are non-detectable per USEPA guidelines.

Individual Distribution System Evaluation (IDSE)

In March 2010 USEPA and VDH approved the Base IDSE plan. The sampling is schedule to begin in October 2013. This evaluation of the distribution system will allow the Base to better monitor disinfection byproducts in the distribution system. Once this information has been obtained and evaluated, the Base will know where to make necessary changes in the distribution system or treatment process.

Conclusion

Thank you for allowing us to continue providing your family with clean, quality water this year. In order to maintain a safe and dependable water supply we sometimes need to make improvements that benefits all of our customers.

As announced in the Base newspaper, *The Quantico Sentry*, water mains and fire hydrants are flushed twice a year. This may cause temporary water discoloration. We apologize for any inconvenience. Our goal is to provide water of excellent quality to every customer. We in the Utilities Section, work around the clock to provide top quality water to every tap.

Our customers can help protect themselves and our water system by careful use of this resource, which is the heart of our community, our way of life and our children's future.

Stay Hydrated!

Our energy level is greatly affected by the amount of water we drink. A 5% drop in body fluids will cause a 25-30% loss of energy in the average person.

- If you lose 5% of your body's water, you will likely run a fever.
- If you lose 10% of your body's water, you will have difficulty moving and may not be able to move at all.
- Losing 12% of your body's water can result in death.
- Most people can exist for over 30 days without food, but only 4-7 days without water. Even mild dehydration will slow down metabolism as much as 3%.
- One glass of water will reduce midnight hunger pangs for most people.



- Water leaves the stomach five minutes after consumption.
- Lack of water is one of the primary triggers of daytime fatigue.
- Preliminary research indicates that 8-10 glasses of water a day could significantly ease back and joint pain for up to 80% of sufferers.
- A mere 2% drop in body water can trigger fuzzy, short-term memory, trouble with basic math, and difficulty focusing on the computer screen or on a printed page.

Quantico Marine Corps Base Water Quality Report Mainside 2012

Microbiological Results	MCLG	MCL	Percent less than 5% Positive	Highest Value	Monthly Samples	In Compliance	Major Source in Drinking Water
Total Coliform Bacteria	0	One positive sample per Month	0	NA	15	Yes	Naturally present in the environment.
Fecal Coliform	0	A routine sample & a repeat sample are coliform positive & one is also fecal coliform.	NA	NA	NA	Yes	Naturally present in the environment.

We are proud to announce there were no positive samples for 2012.

Primary Regulated Contaminants

Metals (units)	MCLG	AL	90th Percentile	Number of Sites Tested	Number of Sites Exceeding AL	Range Low to Highest	In Compliance	Source
Copper (ppm)	0	1.3	0.239	30	0	0.0225 to 0.476	Yes	Corrosion of household plumbing systems.
Lead (ppb)	0	15	3.94	30	0	<2.0 to 10.1	Yes	Corrosion of household plumbing systems.

The Lead and Copper results are from August and September 2012. All samples are below the EPA Safe Drinking Water Act-Action Level. Next sampling event is scheduled for Summer 2015.

Contaminants (units)	MCLG	MCL	Average	Range Low to High	In Compliance	Source
Fluoride (ppm) from distribution.	Results 4	4	0.70	0.58-0.93	Yes	Added to the drinking water to promote dental health. Erosion of natural deposits. Discharge from fertilizer and aluminum factories.
Chlorine (ppm) Results from distribution system.	MRDLG=4	MRDL=4	1.80	0.20-3.20	Yes	Added to drinking water as a disinfectant.
Barium (ppm)	2	2	One test 0.018	N/A	Yes	Discharge of drilling wastes. Discharge from metal refineries. Erosion of natural deposits.

Radiological (pCi/L)	MCLG	MCL	Average	Range Low to High	Year Tested	In Compliance	Source
Gross Beta	0	50*	one test 1.9	NA	2003	Yes	Erosion of natural deposits.
Radium 228	0	5	0.5	NA	2003	Yes	Erosion of natural deposits.

* EPA considers 50 pCi/l to be the level of concern. Next tests are scheduled for 2013.

Disinfection By-Products (units)	MCLG	MCL	Quarterly Running Annual Average	Range Low to High	In Compliance	Source
Trihalomethane THM (ppb)	0	80	42	12-81	Yes	By-product of disinfection.
Haloacetic Acids Group HAA5 (ppb)	0	60	37	16-57	Yes	By-product of disinfection.

Total Organic Carbons (TOC)	MCLG	MCL	Quarterly Running Annual Average	Range Low to High	In Compliance	Source
	N/A	TT	1.48	1.0-1.63	Yes	Naturally present in the environment.

TOC does not pose any adverse health effects. It provides a medium for the formation of disinfection byproducts. These byproducts include THMs and HAA5s. Compliance with the TT (removal ratio of 1.0 and higher) reduces the formation of these disinfection byproducts. The removal ratio is determined by the actual TOC removed between the source water and treated water.

Turbidity (NTU)	MCLG	MCL	Annual Average	Range Low to High	Highest Single Measurement	Month with Lowest Average	Source
	N/A	TT	0.04	0.01-0.12	0.12	All results below 0.30	Soil runoff.

Turbidity levels are measured during the treatment process after the water has been filtered, but before disinfection. The turbidity level of filtered water shall be less than or equal to 0.3 NTU in at least 95 percent of the monthly measurements, and at no time exceed 1 NTU.

Secondary Regulated Contaminants

Secondary Contaminants (units)	PMCL	SMCL	Results	In Compliance	Source
Manganese (ppm)	N/A	0.05	One test 0.015	Yes	Naturally present in the environment. May cause water discoloration.
Chloride (ppm)	N/A	250	One test 8.6	Yes	Naturally present in environment
Sulfate (ppm)	N/A	250	One test 38.6	Yes	Naturally present in the environment; addition of water treatment substances.
Total Dissolved Solid (ppm)	N/A	500	One test 106	Yes	Naturally present in environment

Non Regulated Contaminants Monitored

Non Regulated Contaminants (units)	MCLG	MCL	Results	In Compliance	Source
Bromodichloromethane (ppb)	NRL	NRL	One test 2.6, samples from entry point	NA	By-product of drinking water disinfection.
Chloroform (ppb)	NRL	NRL	One test 9.2, samples from entry point	NA	By-product of drinking water disinfection.
Sodium (ppm)	NRL	NRL	One test 25.6, samples from entry point	NA	Naturally present in the environment; addition of water treatment substances.

Key to Acronyms and Abbreviations

Non-Detects (ND)	Laboratory analysis indicates that the constituent is below the detection level.
Parts per million (PPM) & Milligrams per liter (MG/L)	Parts per million and milligrams per liter are the same. One part per million corresponds to one minute in two years, or a penny in \$10,000.
Parts per billion (PPB) & Micrograms per liter (ug/L)	Parts per billion and Micrograms per liter are the same. One part per billion corresponds to one minute in 2000 years, or a penny in \$10,000,000.
Picocuries per liter (pCi/l)	Picocuries per liter is a measure of the radioactivity in the water.
Nephelometric (NTU) Turbidity unit measurement	Nephelometric turbidity unit is a measure of the clarity of water. Turbidity in excess of 5 NTU is just visibly cloudy with the naked eye.
Action Level (AL)	Concentration of a contaminant which, if exceeded, triggers treatment or other requirements a water system must follow.
Treatment Techniques (TT)	A treatment technique is a required process intended to reduce level of contaminant in drinking water
Maximum Contaminant Level (MCL)	The highest level of a contaminate that is allowed in drinking water. MCL's are set as close to the MCLG's as feasible using the best available treatment technology
Maximum Contaminant Level Goal (MCLG)	The "Goal" (MCLG) is the level of a contaminant in drinking water below which there is no known or expected risk to MCLG's allow for a margin of safety.
Maximum Residual Disinfection Level (MRDL)	The highest level of disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfection is necessary for control of microbial contaminants.
Maximum Residual Disinfection Level Goal (MRDLG)	The level of a drinking water disinfectant below which there is no known or expected risk to health. MRDLG does not reflect the benefits of the use of disinfectants.
No Regulatory Limit (NRL)	A substance or chemical constituent that is of interest but currently does not have a regulatory limit or concentration.